

# Type test Certificate of short-circuit performance

## **Astor Transformer**

Ankara, Turkey

has successfully passed the type test sequence on a three-phase oil-immersed type

## **power transformer**

Type: PTR 100000 /170G

Rating: 100 MVA – 154 kV $\pm$  12 x 1,25% / 33,6 kV - Ynyn0 – 50 Hz

The test object passed the required clauses of


## **IEC 60076-5**

The test results are recorded in Certificate No.

# **2182-15**


This Certificate is issued on 23 October 2015.

KEMA Nederland B.V.

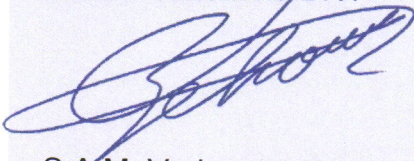

S.A.M. Verhoeven

Director Testing, Inspections & Certification The Netherlands

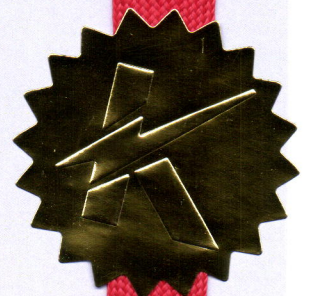

Copyright © KEMA Nederland B.V.

Please note that this document has been issued for information purposes only, and that the original bound and sealed paper copy of the Certificate including the results of the tests of the apparatus will prevail. This document does not imply that KEMA has certified or approved any apparatus other than the specimen tested.